




EFW BODEN

BODEN, SWEDEN

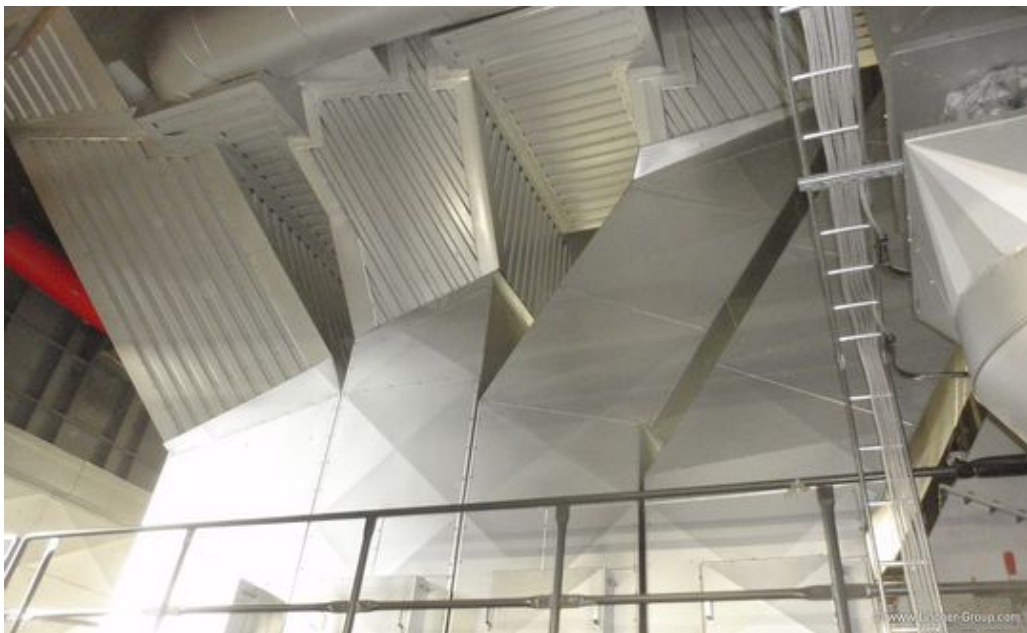

Description:

Bodens Energi AB expanded its existing plant in Boden with a new waste-fired CHP line (P18) with a thermal capacity of 35 MW. The P18 line was integrated into the existing plant and housed in a new, separate building.

Lindner insulated the boiler, ducts and piping over an area of 5,900 square metres.

General:

Concept/Product:	Insulation engineering
Building Type:	Power plants/Power station
Client:	Bodens Energie AB
Client's Representative:	Babcock & Wilcox Vølund A/S
Company Division:	Lindner Isoliertechnik & Industrieservice GmbH
Completion:	2018



Completed Works:

Insulation of power stations

Insulation







© www.Lindner-Group.com