

# EfW Boden

Boden, Sweden





© www.Lindner-Group.com

# Project Description


Bodens Energi AB expanded its existing plant in Boden with a new waste-fired CHP line (P18) with a thermal capacity of 35 MW. The P18 line was integrated into the existing plant and housed in a new, separate building. Lindner insulated the boiler, ducts and piping over an area of 5,900 square metres.

## General

<b>Building Type</b>	Power Plants, Industrial and commercial construction
<b>Company Division</b>	Lindner Bautechnik GmbH
<b>Completion</b>	2018
<b>Client</b>	Bodens Energie AB

## Completed Works

- Insulation Engineering 5900 sqm

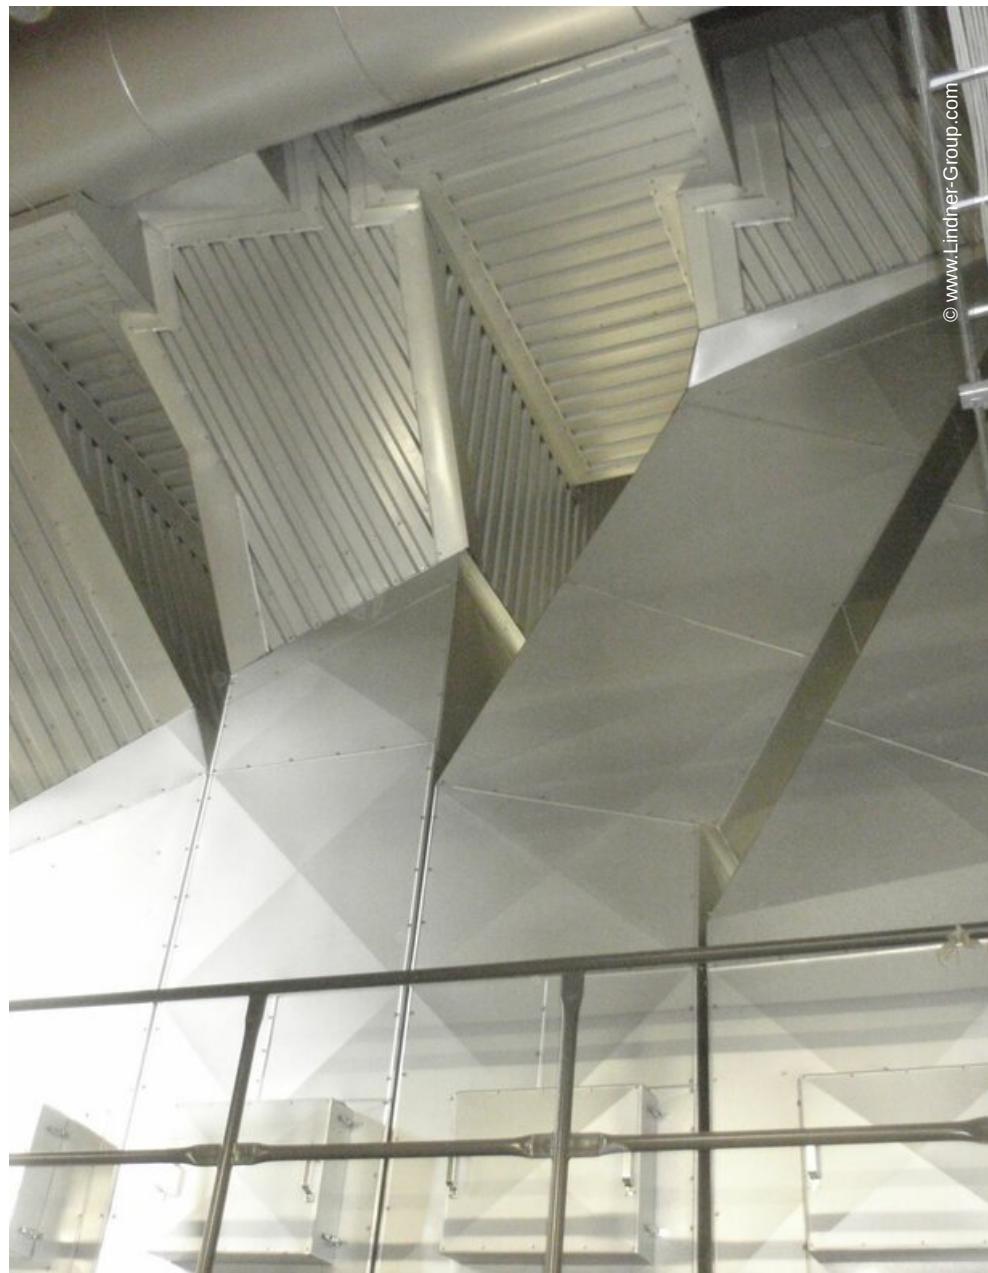

© www.Lindner-Group.com



© www.Lindner-Group.com

